

**DISCONNECT POWER CORD BEFORE SERVICING  
IMPORTANT - RECONNECT ALL GROUNDING DEVICES**

All parts of this appliance capable of conducting electrical current are grounded. If grounding wires, screws, straps, clips, nuts or washers used to complete a path to ground are removed for service, they must be returned to their original position and properly fastened.

**IMPORTANT SAFETY NOTICE**

This information is intended for use by individuals possessing adequate backgrounds of electrical, electronic and mechanical experience. Any attempt to repair a major appliance may result in personal injury and property damage. The manufacturer or seller cannot be responsible for the interpretation of this information, nor can it assume any liability in connection with its use.

**ELECTRICAL SPECIFICATIONS**

|   |                   |
|---|-------------------|
| Temperature Control (Position 5) .....  | 30-22°F.          |
| Defrost Control .....                   | 15 hrs. @ 44 min. |
| Defrost Thermostat .....                | 55-25°F.          |
| Electrical Rating: 115V. AC 60 Hz. .... | 7.0 Amp.          |
| Maximum Current Leakage .....           | 0.50 mA.          |
| Maximum Ground Path Resistance .....    | 0.14 Ohms         |
| Energy Consumption (Humid) - 21 .....   | 64 KWH/mo.        |
| - 22 .....                              | 66 KWH/mo.        |

**NO LOAD PERFORMANCE**

|   |              |              |
|---|--------------|--------------|
| Control Position 5/C<br>and Ambient of: | <b>70°F.</b> | <b>90°F.</b> |
| Fresh Food, °F. ....                    | 36-42        | 38-42        |
| Frozen Food, °F. ....                   | 0-6          | (-1)-3       |
| Run Time, % .....                       | 28-38        | 50-66        |


**REFRIGERATION SYSTEM**

|                                   |             |
|-----------------------------------|-------------|
| Refrigerant Charge (R-12) .....   | 6¼ ounces   |
| Compressor .....                  | 610 BTU/hr. |
| Minimum Compressor Capacity ..... | 22 inches   |
| Minimum Equalized Pressure        |             |
| @ 70°F. ....                      | 41 PSIG     |
| @ 90°F. ....                      | 49 PSIG     |


**INSTALLATION**

Clearance must be provided for air circulation:  
 AT TOP ..... 1-inch  
 AT SIDES ..... 3/4-inch  
 AT REAR ..... 1-inch

**AIR FLOW**

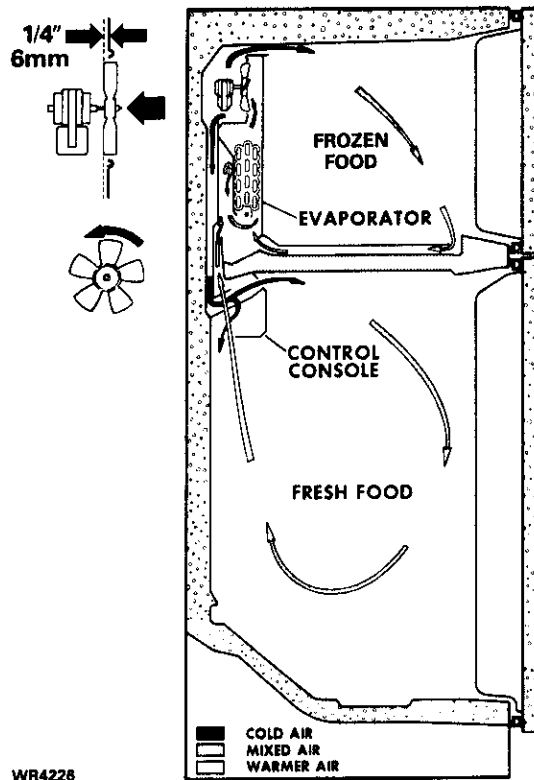


WR4228

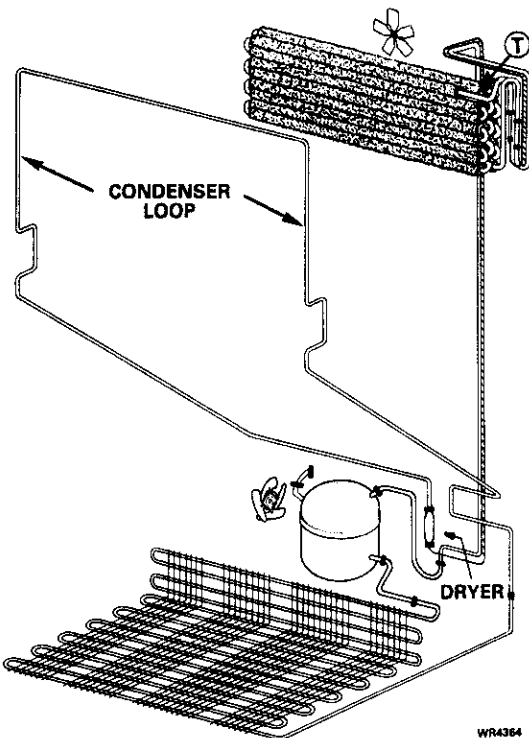

WR4364

**REPLACEMENT PARTS**

|                                    |           |
|------------------------------------|-----------|
| Temperature Control .....          | WR09X0517 |
| Relay .....                        | WR07X0240 |
| Overload .....                     | WR08X0163 |
| Run Capacitor .....                | WR62X0079 |
| Defrost Control .....              | WR09X0520 |
| Defrost Thermostat .....           | WR50X0131 |
| Defrost Heater Kit (W/Fuses) ..... | WR51X0431 |
| Condenser Fan Motor .....          | WR60X0179 |
| Evaporator Fan Motor .....         | WR60X0190 |

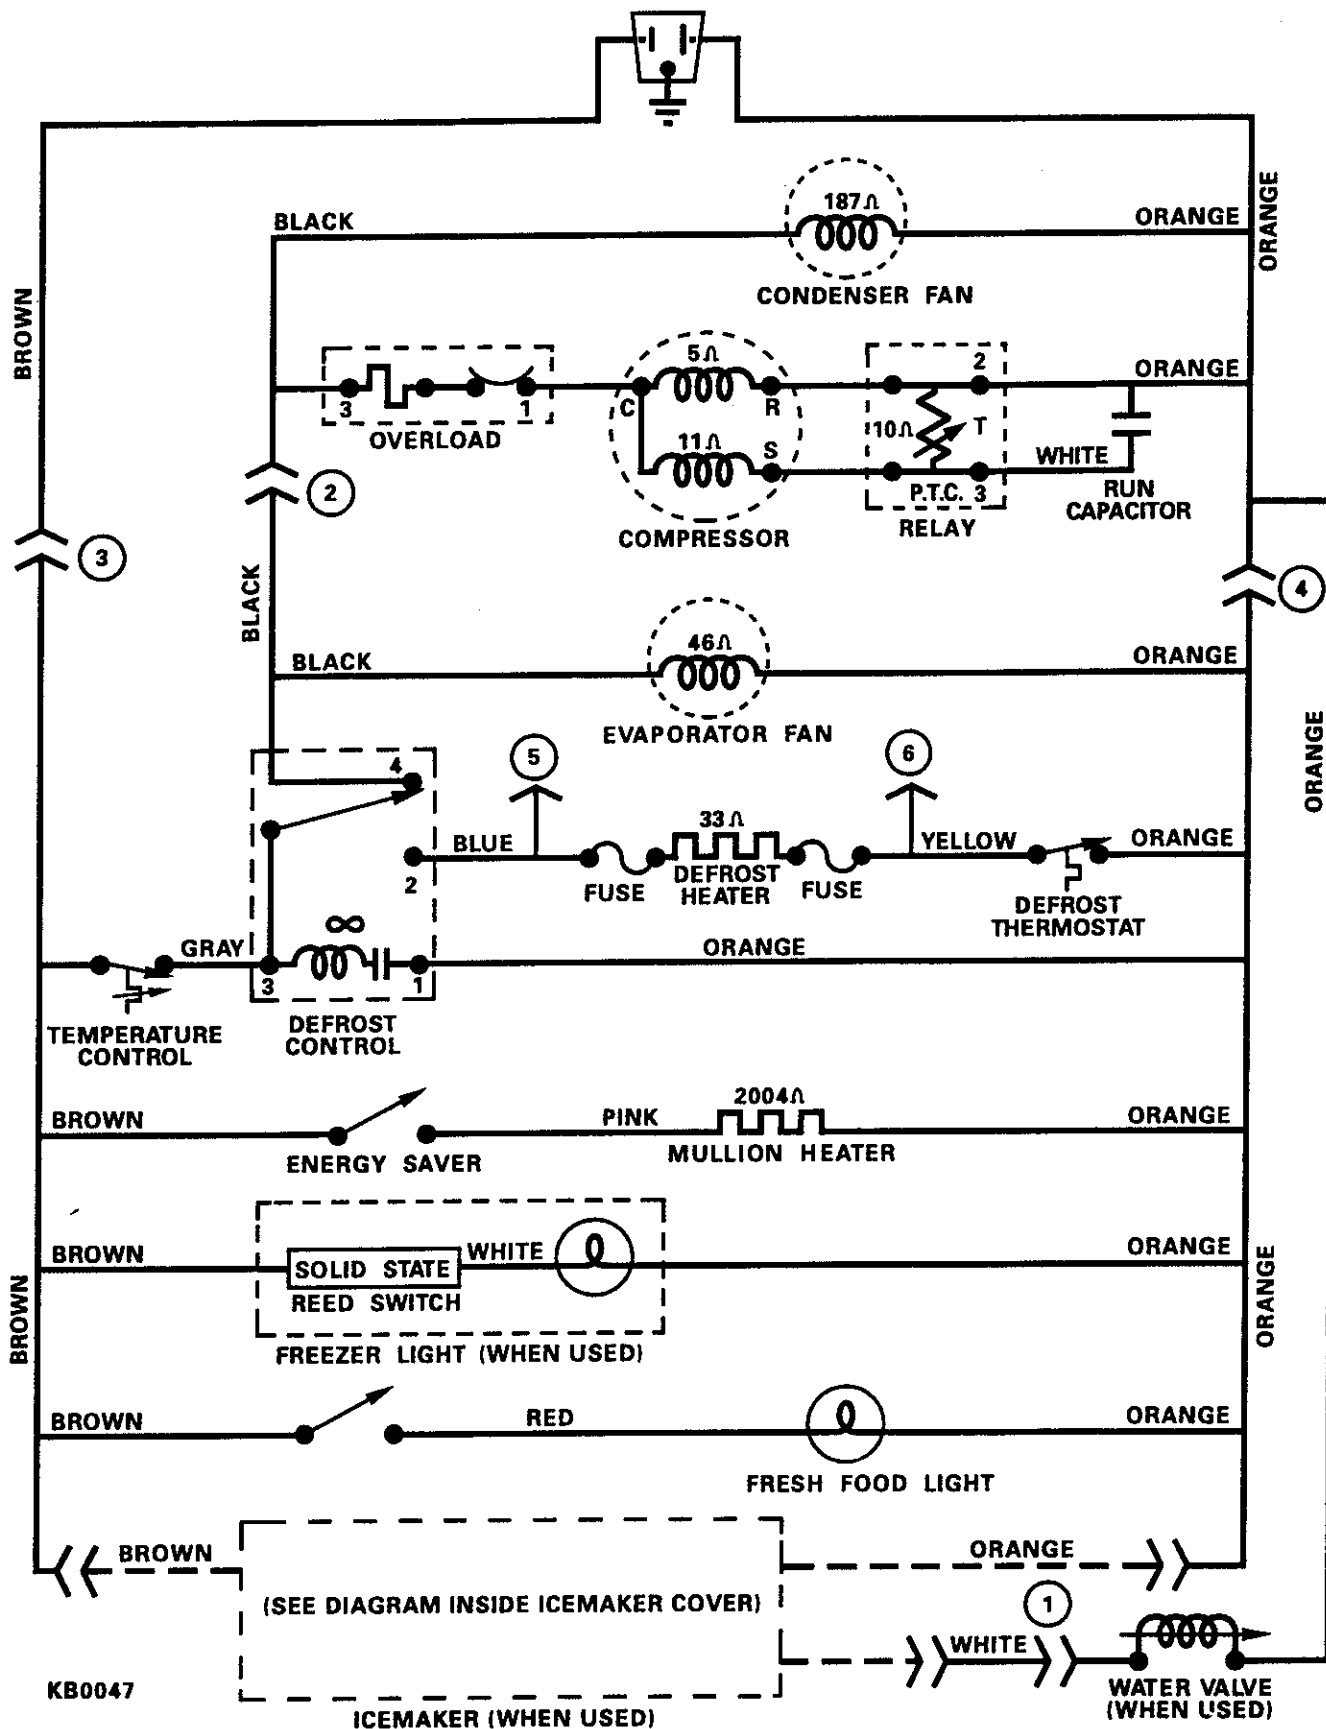

KB0047

